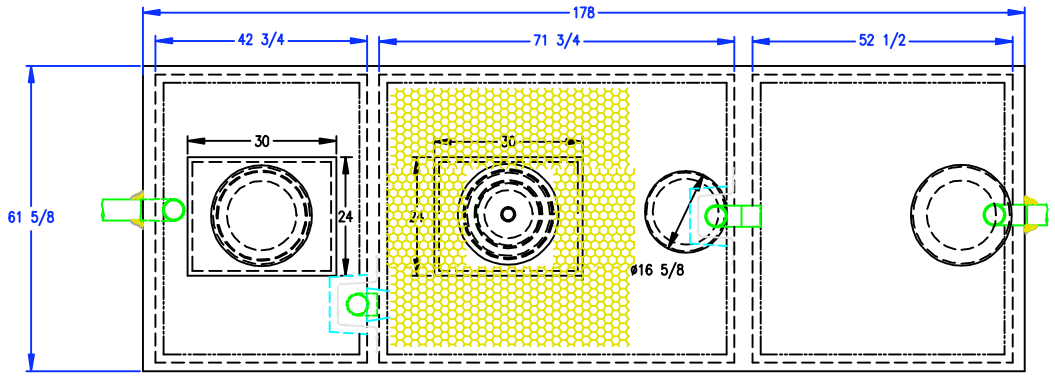

NOTES:

1.) AERATOR MODEL 700LL MUST BE USED IN CONTINUOUS OPERATION.

2.) IF AERATOR MOUNTING CASTING HAS NO RISER, RISERS ARE NOT REQUIRED HERE. REMOVABLE CONCRETE COVERS, OR PLASTIC COVERS SECURED WITH TAMPER RESISTANT FASTNERS ARE REQUIRED.

3.) IF AERATOR MOUNTING CASTING HAS A RISER(S), COVERED RISERS ARE REQUIRED HERE. RISERS SHOULD BE DEVELOPED TO GRADE OR TO 6"–12" BELOW GRADE.

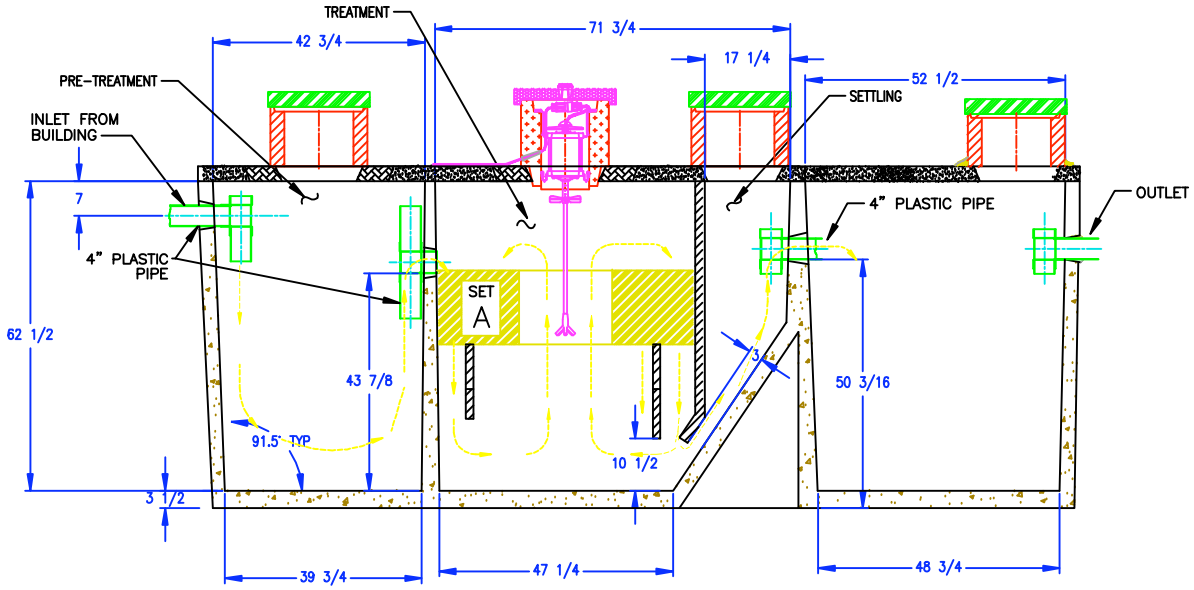

TANK AND LID ASSEMBLY

ITEM	REQ'D	PART NO.	DESCRIPTION						
I	H	G	F	E	D	C	B	A	REV.
									EN NO.
								8/24/07	DATE

JET INC.
©200_ Jet, Inc. All Rights Reserved
CLEVELAND, OHIO

DRAWN BY: SDZ | DATE: 03-10-08
APPROVED BY: | DATE:
MATERIAL:
SCALE:

TITLE: J500 WITH PUMP TANK

USED ON:

UNLESS OTHERWISE SPECIFIED:
ALL DIMENSIONS IN INCHES
DECIMAL: ± .005
FRACTION: ± 1/64
DEGREE: ± 1°

C

Confidential and Proprietary Property of Jet, Inc. – No part of this drawing may be published, reproduced, copied, or used in any form, without the prior written permission of Jet, Inc.

DRAWING NUMBER: